


Investigation of the mechanical strength of 765 kV Double Suspension 'V' Composite Insulator String with Hardware fittings for M/s Power Grid Corporation of India Limited.

M/s TAG Corporation, Chennai, India., have referred to CSIR-Structural Engineering Research Centre, Chennai to investigate the mechanical strength of 765 kV Double Suspension 'V' Composite Insulator String with Hardware fittings suitable for Quadruple ACSR Bersimis Conductor (For Delta Tower) for **M/s Power Grid Corporation of India Limited.**

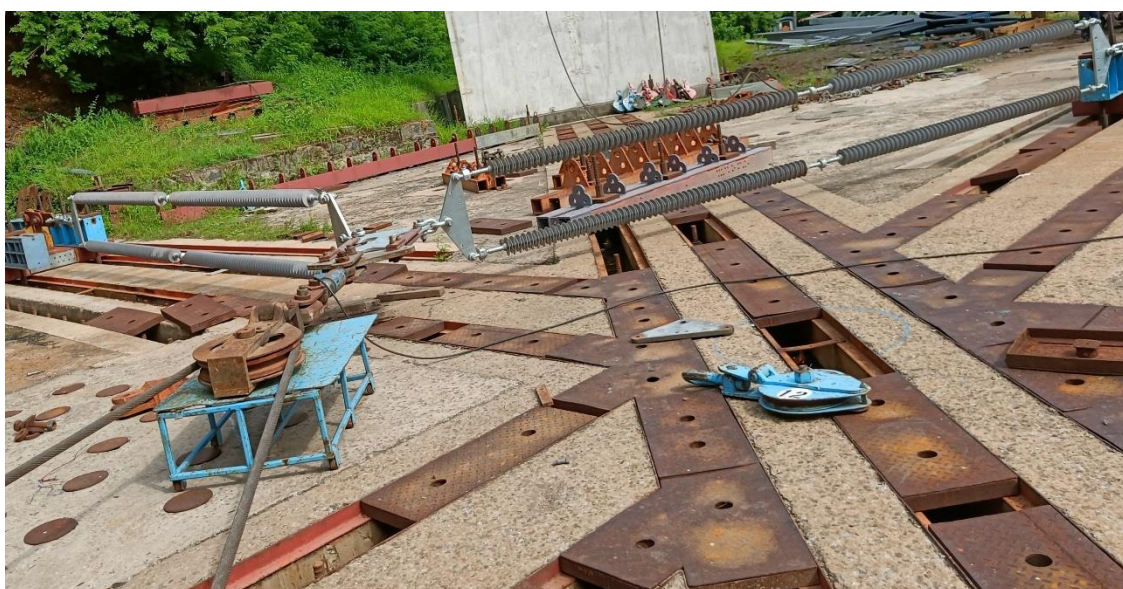

TESTING OF DOUBLE SUSPENSION 'V' STRING